


OPERATION AND MAINTENANCE MANUAL (OMM)

Automatic rolling curtain mcr PROSMOKE FS CE

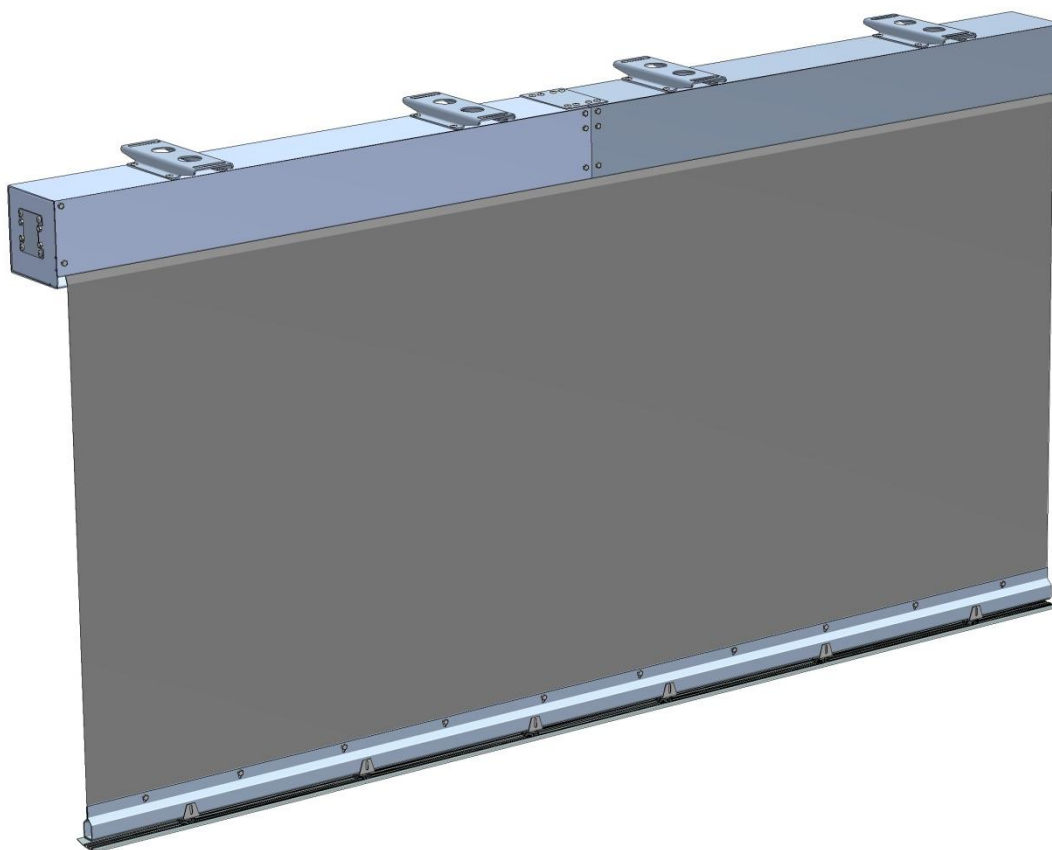

Nr dok: HO.25.02531.DOCX

Rev: B

Table of contents

1. INTRODUCTION	2
2. PURPOSE OF THE DEVICE	2
3. DESIGN OF CURTAINS.....	3
4. OPERATING PRINCIPLE OF mcr PROSMOKE FS CE CURTAINS.....	8
5. TRANSPORT AND DELIVERY.....	8
6. INSTALLATION OF CURTAINS	8
6.1. Curtain installation should be carried out as follows:	9
6.2. Limit switch adjustment:.....	11
7. WARRANTY TERMS AND CONDITIONS.....	21
8. CERTIFICATE CPR	22

1. INTRODUCTION

The aim of this Operation and Maintenance Manual is to make the user familiar with the intended use, design, operating principle, correct installation and operation of mcr PROSMOKE FS CE automatic rolling curtains. The OMM also contains additional information on the conditions of use, maintenance and warranty of the product.

Complying with the recommendations included in the OMM will ensure proper functioning of the smoke venting systems as well as the safety of their users.

Mercor Light&Vent reserves the right to make changes to the product or to this document without prior notice.

The Operation and Maintenance Manual applies to mcr PROSMOKE FS CE curtains with a limit switch for a smooth adjustment of the upper position (by using the XL40/17M drive supplied by BECKER – Antriebe GmbH), the so-called mcr PROSMOKE FS CE version 2.

2. PURPOSE OF THE DEVICE

mcr PROSMOKE FS CE rolling curtains form part of a smoke control system also including other products by Mercor Light&Vent, such as mcr PROLIGHT point smoke exhaust vents, mcr PROLIGHT system skylights and smoke exhaust vents integrated with continuous rooflights, mcr 9705 and mcr 0204 smoke exhaust control units, and others.

mcr PROSMOKE FS CE rolling curtains are used to define smoke zone in the space under the ceiling in smoke and heat gravitational exhaust systems. Fire smoke is collected in the smoke containers, and then is removed by smoke exhaust vents, e.g. mcr PROLIGHT. Defining smoke zone in the space under the ceiling, the curtains confine the spread of smoke, prevent it from cooling off and form a smoke layer of a designed thickness, ensuring appropriate conditions for mcr PROLIGHT smoke exhaust vents to operate in.

mcr PROSMOKE FS CE smoke curtains have a  certificate of conformity (No. 1396-CPR-0033) with the requirements of the EN 12101-1:2005, EN 12101-1:2005/A1:2006 standard, issued by a notified certification body No. 1396.

The building designer is responsible for a proper design of the venting system and for the selection of appropriate curtains for a specific application. mcr PROSMOKE FS CE curtains are not intended to be used as smoke control doors. The curtains are fire protection devices. They cannot function as gates or anything similar and they are not designed to be activated/used every day for other purposes.

3. DESIGN OF CURTAINS

Rolling curtains consist of a casing, a roller with smoke-tight fabric (with a bottom bar) wound onto it and a drive system (Fig. 1).

The casing is composed of two elements – a fixed part and an access cover type K, C, L, K-T (Fig. 3, Fig. 4).

The roller is mounted inside the casing by means of a bearing unit with a pivot on the one side and on the motor spindle on the other. In specific cases, a second drive system can be applied instead of a bearing unit.

The drive system mounted in the roller consists of a 230 V AC motor, a 24 V DC brake keeping the fabric rolled up, and an additional brake limiting the rate of dropping down.

The smoke-tight fabric has a bottom bar ensuring correct rolling out and rolling up and minimising the risk of bending and lifting the fabric when affected by the pressure of fire gases. The bottom bar may be optionally equipped with a masking element (Fig. 5, Fig. 6).

The masking element is an 80 mm wide aluminium profile painted to order in any RAL colour.

The smoke-tight fabric used in mcr PROSMOKE FS CE curtains is not trimmed at the edges. Slight edge fraying is natural and does not affect the operation and product quality.

The curtain casing houses the MECU XL control system ensuring correct operation of the curtain.

Single curtains are up to 6 m long. If longer curtains are needed, a proper number of shorter curtains are put together to form a unit of the desired length.

The curtain may be optionally equipped with gap-reducing side guides.

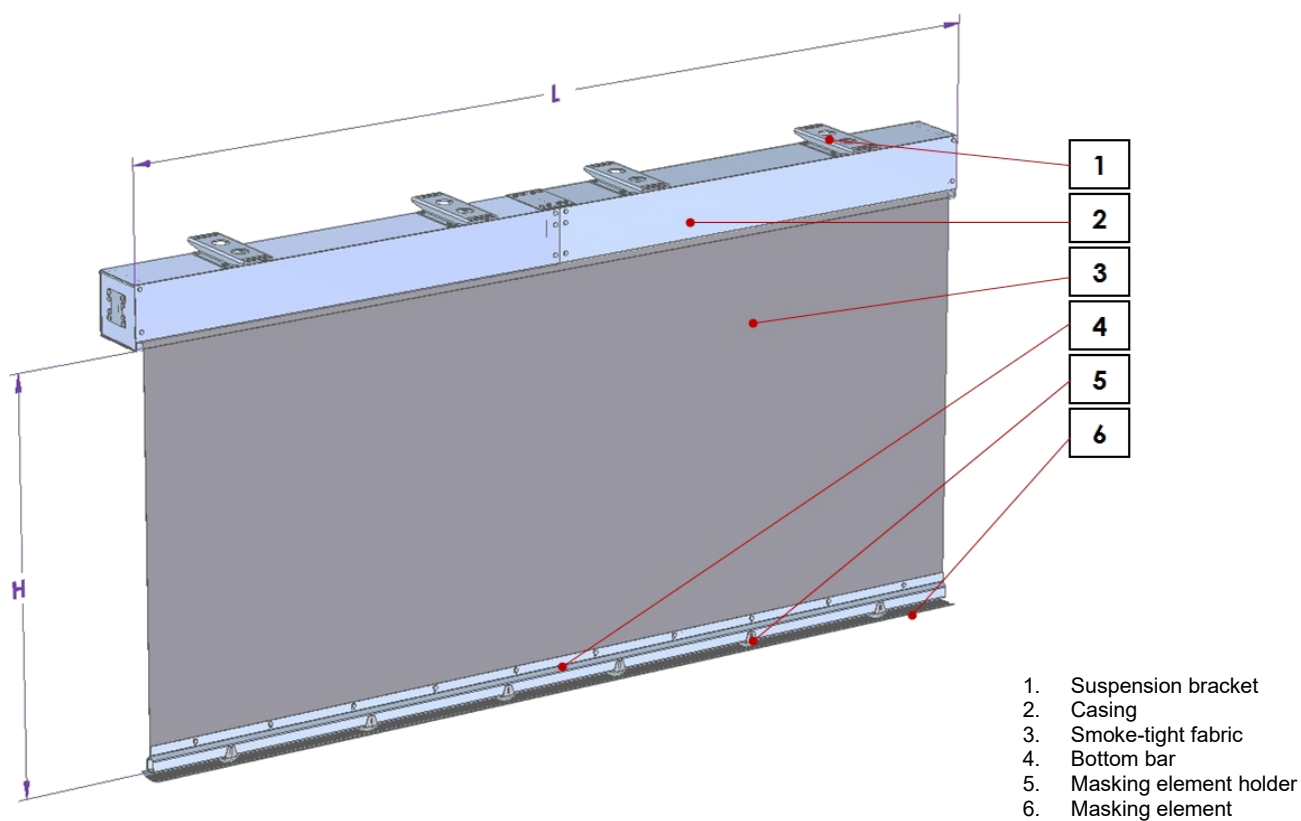


Fig. 1 mcr PROSMOKE FS CE rolling smoke curtain – design.

NOTE: When planning the curtain installation, the presence of any elements projecting beyond the casing outline should be taken into account:

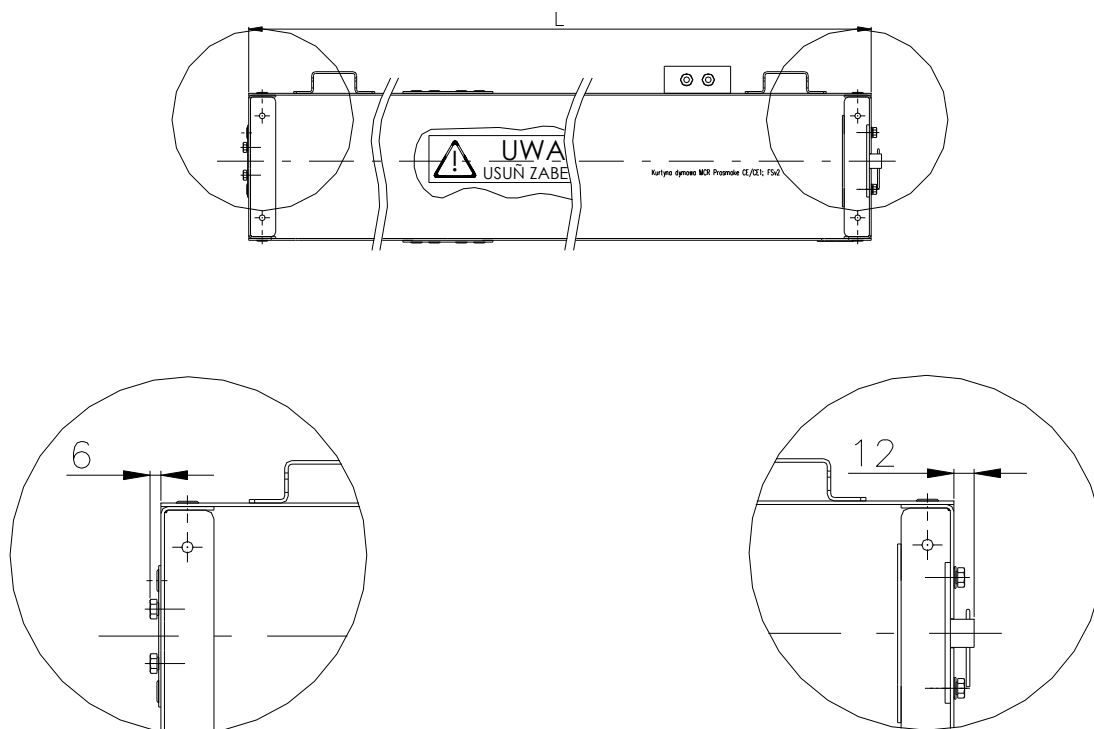


Fig. 2 Lengths of elements projecting beyond the mcr PROSMOKE FS CE curtain casing outline.

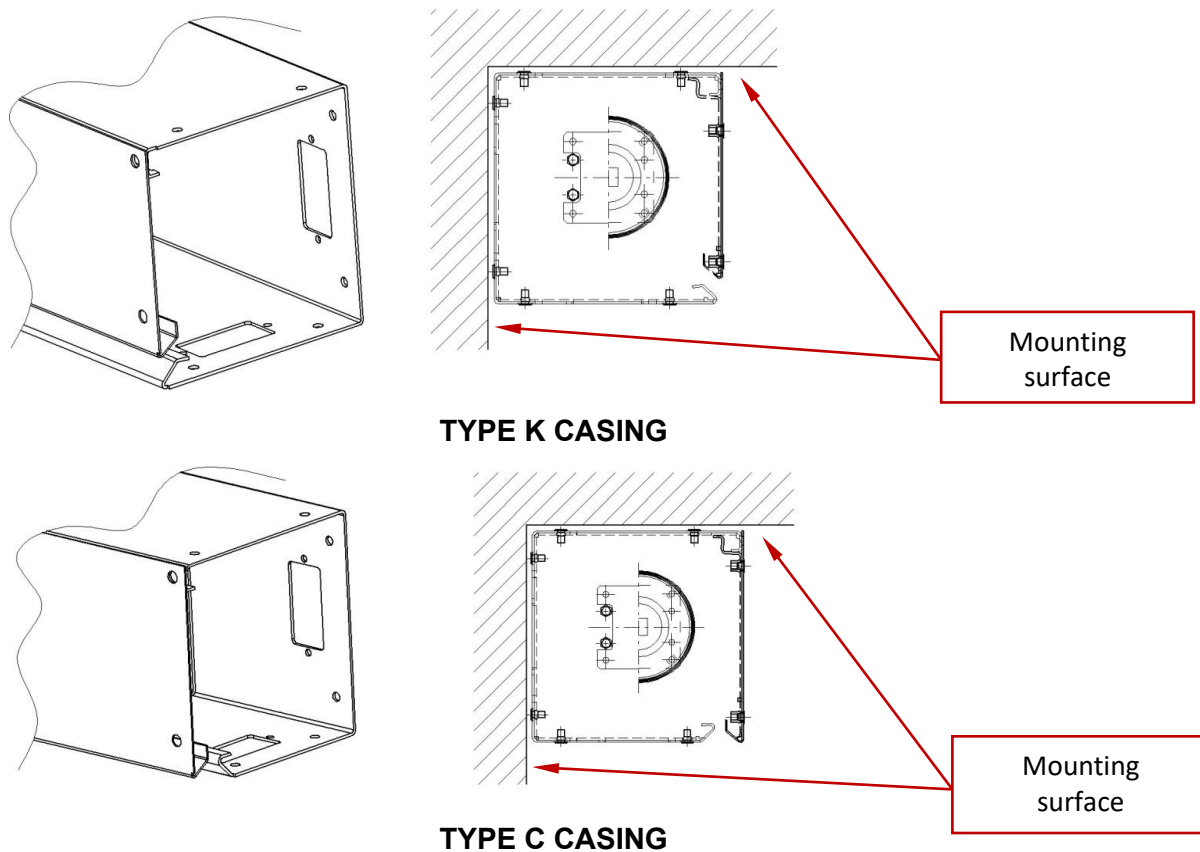


Fig. 3 Curtain casing types – K, C.



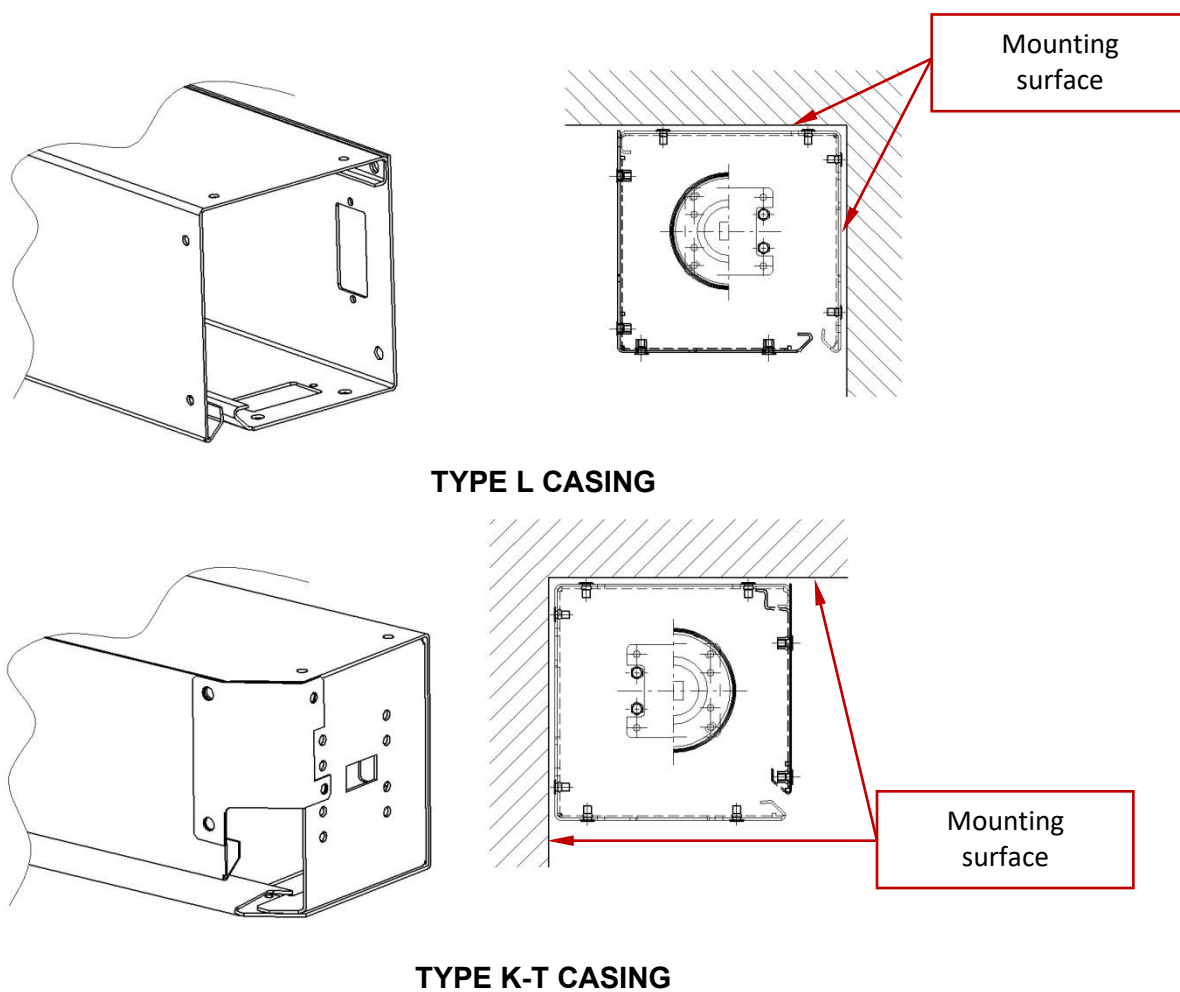


Fig. 4 Curtain casing types – L, K-T.

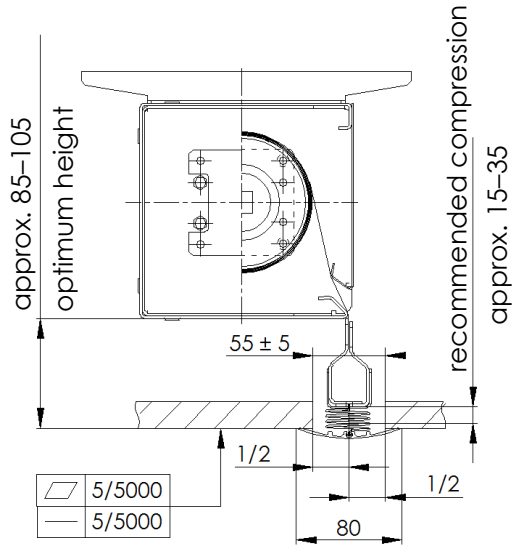

NOTE: ensure straightness and flatness (5 mm / 5000 mm) of the drop ceiling surface around the gap

Fig. 5 Recommended position of casings relative to the ceiling. Gap width.

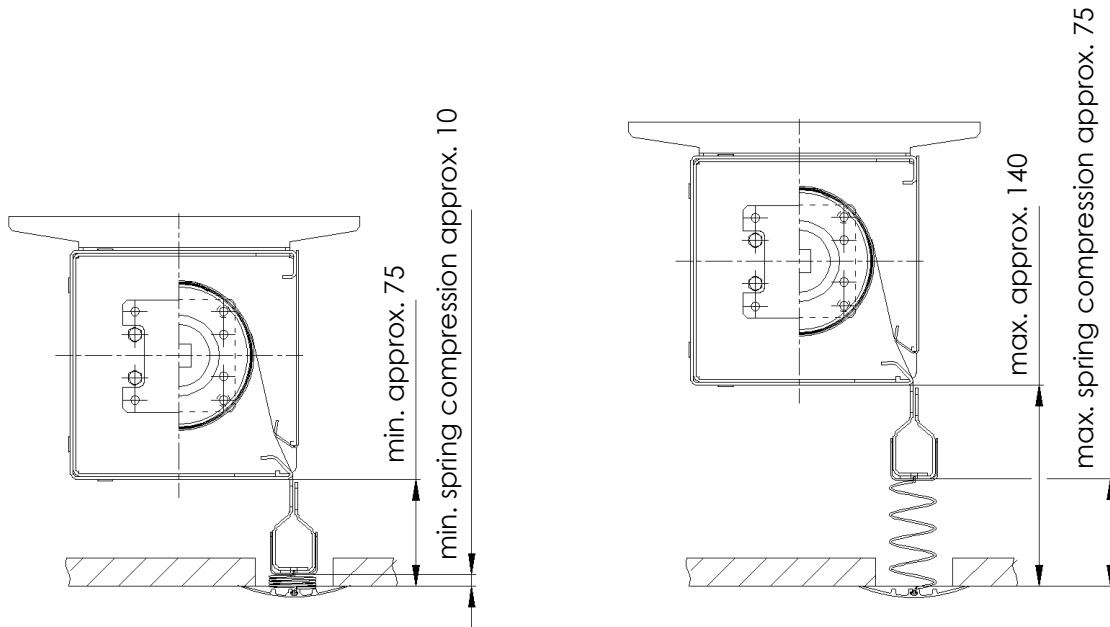

NOTE: Observe the minimum and maximum spring compression values. The distance between the casing and the ceiling is approximate.

Fig. 6 The maximum and minimum distance between the casing and the ceiling and the minimum spring compression.

4. OPERATING PRINCIPLE OF mcr PROSMOKE FS CE CURTAINS

When in standby mode, mcr PROSMOKE FS CE rolling curtains are hidden in casings. In case of fire, they automatically roll out to the predetermined height.

In order to function properly, a mcr PROSMOKE FS CE rolling curtain must be connected to a mcr 9705-5A or mcr 0204 smoke vent control unit. In order to keep the mcr PROSMOKE FS CE curtain rolled up, a non-interrupted power supply from the mcr 9705 or mcr 0204 smoke vent control unit is required. If the power supply from the control unit to the curtain is interrupted for one of the following reasons:

- alarm signal,
- disconnection or power shortage (including burning out in case of fire) of the circuit connecting the mcr 9705 or mcr 0204 control unit with the MECU XL motor control system,
- failure of 230 V AC power supply to the mcr 9705 or mcr 0204 and discharged control unit batteries – the brake is released and the curtain fabric drops down in a controlled manner to the required height (until it is fully rolled out).

The mcr 9705-5A control unit interacting with the curtain should be set to the door control mode, while the mcr 0204 control unit should be set to the curtain mode.

After the mcr 9705 or mcr 0204 control unit is returned to the standby mode, the curtain fabric rolls up using a 230 V AC motor. The fabric rolls up until it reaches the height set by the motor limit switch. When it does, the curtain goes into the mode of keeping the fabric rolled up.

5. TRANSPORT AND DELIVERY

Curtains are generally supplied pre-assembled. Unloading must be carried out under the supervision of a person authorised by the manufacturer, using generally available means of handling (e.g. forklift trucks, cranes equipped with spreader boom slings) or manually, paying special attention to the protection of curtains against damage.

6. INSTALLATION OF CURTAINS

Do not disassemble and do not disconnect the MECU XL motor control system from the motor. Each curtain model requires a 230 V AC supply voltage.

Curtains should be installed in civil structures in accordance with their respective construction designs, in order to ensure the design gap sizes.

Curtains should be fixed under the ceiling, to lintels, prepared structures or other building features intended for this purpose as per the construction design. The structural component should be made of concrete or steel. When designing the structural component, the device weight should be taken into account: approx. 200 ÷ 300 N/m, depending on the curtain height. For curtains without brackets, the mounting surface should be vertical or horizontal, with a flatness deviation of up to 5 mm along the curtain length.

Curtains mounted on suspension brackets of more than 0.5 m in length should be strengthened by attaching the casing e.g. to a reinforced concrete wall, a girder, etc. As to multi-modular casings, they should be fastened together as shown in (Fig. 10) by means of self-drilling screws or rivets not longer than 20 mm, so that uncontrolled movements of casings relative to each other are eliminated.

6.1. Curtain installation should be carried out as follows:

Curtains with brackets:

1. Mount M10 or M12 threaded rods of suitable length in the structural component to match the arrangement of brackets (Fig. 8).
To mount the threaded rods, use fasteners suitable for the structural component material (e.g. HK8 HILTI anchors).
2. Screw M10 or M12 nuts onto the rods.
3. Hang the curtain on the rods using a M10 or M12 rough finish washer and a nut with protection cap.
4. Using the nuts, adjust the horizontal position of the curtain casing.
5. Tighten the nuts driven according to item 2, check if the fastenings are secure.
6. Connect the free terminals of MECU XL (Fig. 13) to the control device, i.e. the mcr 9705 or mcr 0204 control unit, and to the 230 V AC power supply. Observe polarity (+ to +, - to -). The mcr 9507 control unit should be set to the door control mode or the mcr 0204 control unit should be set to the curtain control mode.
7. Install the side guides, if ordered, using steel fasteners.
8. For curtains above 4 m, remove the transport foams placed inside the curtain, in the middle part of the module, between the drum and the casing.
9. Make sure that there are no obstacles under the curtain and check if the curtain rolls out to the desired height and rolls up properly. Adjust the length of the fabric feed, if required (see: "Limit switch adjustment:" – page 11).
10. Check the system operation by triggering the alarm from all available sources.

Curtains without brackets:

1. Unscrew the access cover.
2. Remove the roller with fabric, i.e.:
 - a. Remove the pin locking the motor.
 - b. Unscrew the four screws securing the plate protecting the drive.
 - c. Unscrew the four screws securing the roller support located on the opposite side of the motor.
 - d. Pull out the shaft end with a plug (opposite the motor).
 - e. Remove the roller from the casing.
3. Make mounting holes in the casing.
4. Mount the curtain housing using steel fasteners adequate for the substrate material and for the position of the mounting surface (ceiling/wall): fasteners with a joining element of at least Ø10 in diameter are recommended, e.g. M10 (such as HK8 HILTI anchors). Note the length of the fastener inside the casing as it cannot damage the fabric.
5. When the casing has been installed, put the roller with fabric inside. Follow the above steps in reverse order. Make sure that the position of the roller is the same as before removing it.
6. Secure the roller by locking pins at both ends.
7. Install the side guides, if ordered, using steel fasteners.
Connect the free terminals of MECU XL (Fig. 13) to the control device, i.e. the mcr 9705 or mcr 0204 control unit, and to the 230 V AC power supply. Observe polarity (+ to +, - to -). The mcr 9507 control unit should be set to the door control mode (see the OMM of the smoke vent control unit) or the mcr 0204 control unit should be set to the curtain control mode.
8. For curtains above 4 m, remove the transport foams placed inside the curtain, in the middle part of the module, between the drum and the casing.
9. Make sure that there are no obstacles under the curtain and check if the curtain rolls out to the desired height and rolls up properly. Adjust the length of the fabric feed, if required (see: "Limit switch adjustment:" – page 11).
10. Having checked and adjusted it, close the access cover.
11. Check the system operation by triggering the alarm from all available sources.

Curtains with a bottom bar masking element:

Masking elements are supplied separately. They are suitable for installation at the already mounted and adjusted curtains.

1. Before installing the masking element, attach the bracket to a spring which is attached to the masking element by default. The installation takes place on site by putting the spring in the prepared slot in the bracket.
2. The masking element with the bottom bar bracket is to be attached using 4.8x13 buttonhead self-drilling screws.
3. Restrictions on the use of the masking element with holders (Fig. 5, Fig. 6).

Multi-modular curtains should be installed following the order of modules (first the edge module, then the central one and then the edge one again) and design sizes of material overlaps in the individual modules.

For a group of curtains with a common bottom bar, all curtain modules should be powered by the same source, i.e. by a single mcr 9705 or mcr 0204 control unit. Electrical connections should be as specified in the OMM of the control units.

The installation of a single bottom bar for a group of curtains and/or the masking element should be as specified in a separate manual.

NOTE: In the case of curtains longer than 4 m, there is foam padding inside the casing.

Make sure to remove it before powering the curtains.

Failure to remove the foam padding may result in damage to the drive or fabric.

Number of modules connected to the panels:

1. Maximum number of modules:

mcr PROSMOKE FS CE modules in the mcr 9705 control unit – 12 modules

mcr PROSMOKE FS CE modules in the mcr 0204 control unit – 8 modules.

If a group of curtains with a higher number of modules is necessary, they should be divided into sections or an extension module should be used to power them.

2. The time of keeping the curtain rolled up by the control unit if there is no primary power supply:
mcr 0204 – up to 12 hours for 1 pcs. (2 pcs. – 6 hours; 3 pcs. – 4 hours, etc.).
mcr 9705 – up to 20 hours for 1 pcs. (2 pcs. – 10 hours; 3 pcs. – 6.5 hours, etc.).
3. The control unit and each curtain module requires a 230 V AC power supply.
4. The maximum power of a 230 V AC motor in a single module is 270 W.

6.2. Limit switch adjustment:

The mcr PROSMOKE FS CE only has the upper position limit switch. The lower position limit switch is blanked off (Pic. 1) – the curtain drops until it is fully rolled out.

1. The limit switch is marked with up/down arrows which correspond to the direction of the motor rotation. +/- symbols indicate the change in range.
2. The switch trigger point can be moved as indicated by the arrow by rotating the adjustment screw towards + or in the opposite direction by rotating the adjustment screw towards -.
3. One turn of the adjustment screw changes the rotation of the motor shaft by approx. 10° (which translates into approx. 1 cm of the curtain fabric).
4. To set the limit switch precisely and to check if it functions correctly, trigger the switch, having first changed its setting by reducing the value by at least ¼ turn.

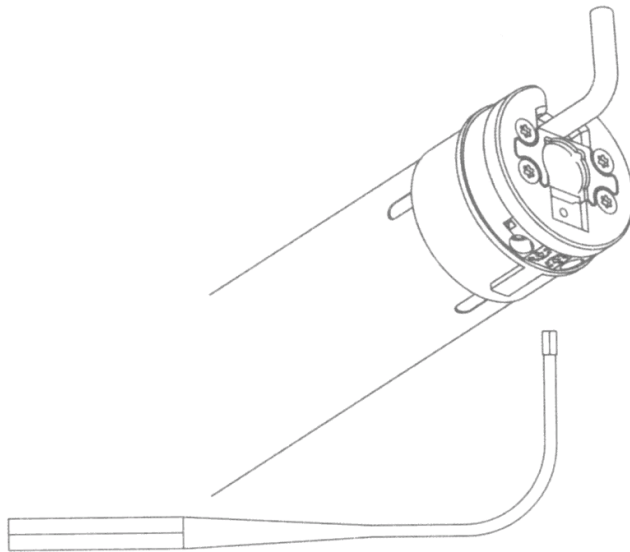



Fig. 7 Curtain limit switch adjustment.




Blanking plug!

Pic. 1 Curtain motor limit switches.

Wide suspension bracket – TYPE A

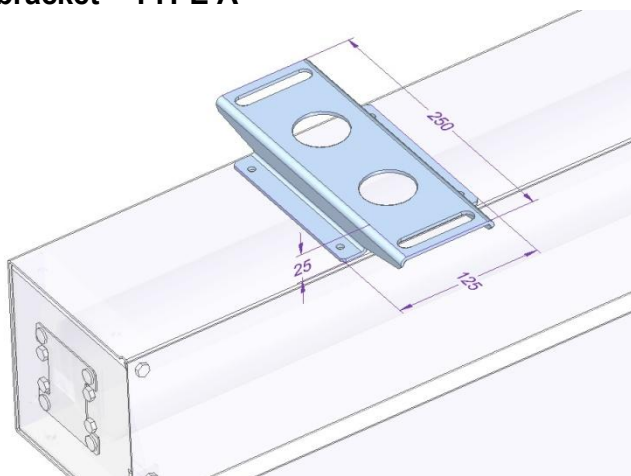

Narrow suspension bracket – TYPE B

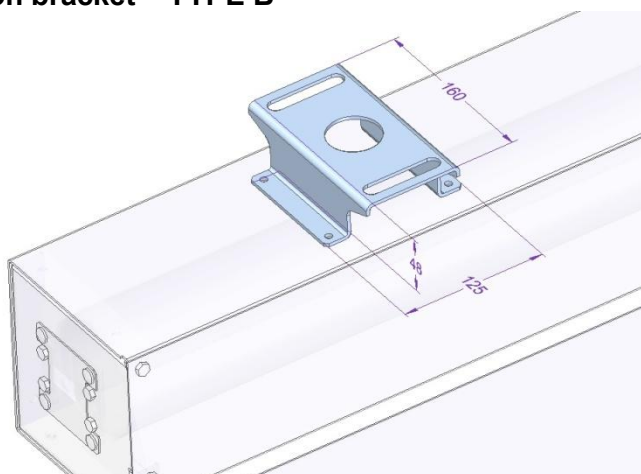

Flat suspension bracket – TYPE C (installation directly to the ceiling only)

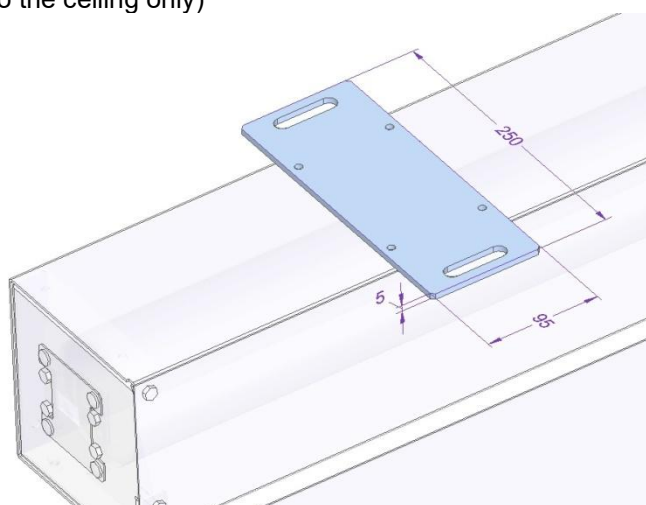


Fig. 8 Suspension bracket types.

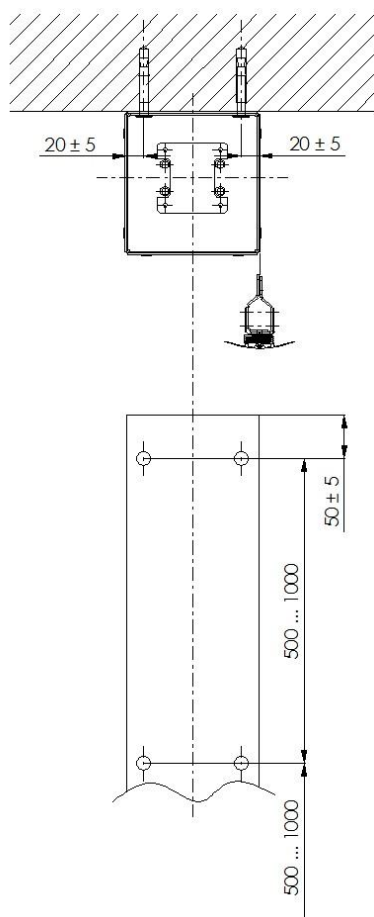


Fig. 9 Installation of a curtain without a suspension bracket.

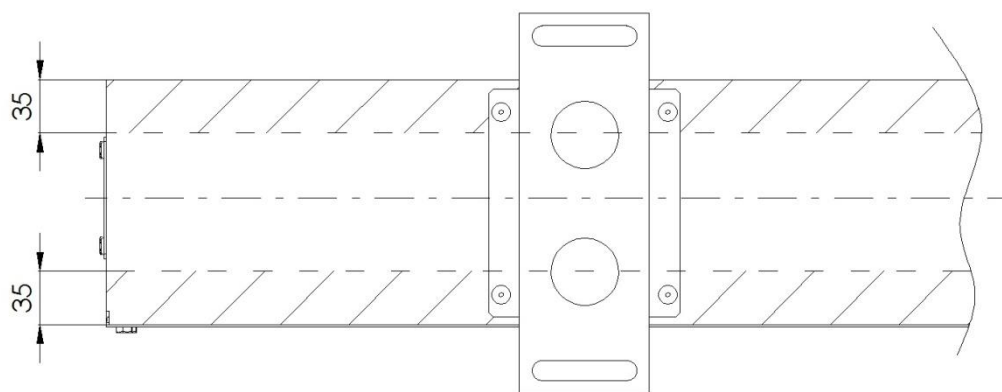


Fig. 10 A spot in the casing designed for connecting curtain modules.

CABLES

Regular cable 2 x 1.5 mm (2.5 mm)

NOTE

In the case of multi-modular curtains, cables of the same length must be used to ensure the same supply voltage drop


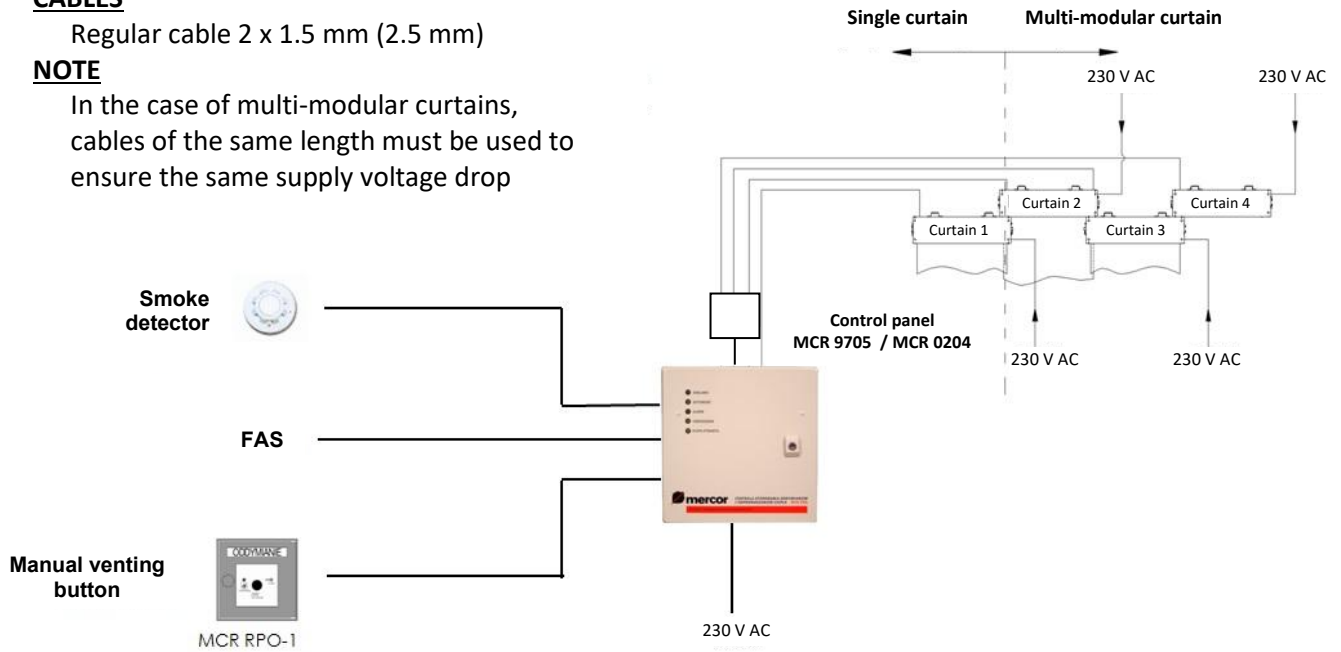


Fig. 11 Schematic diagram of the curtain connections with a common bottom bar.

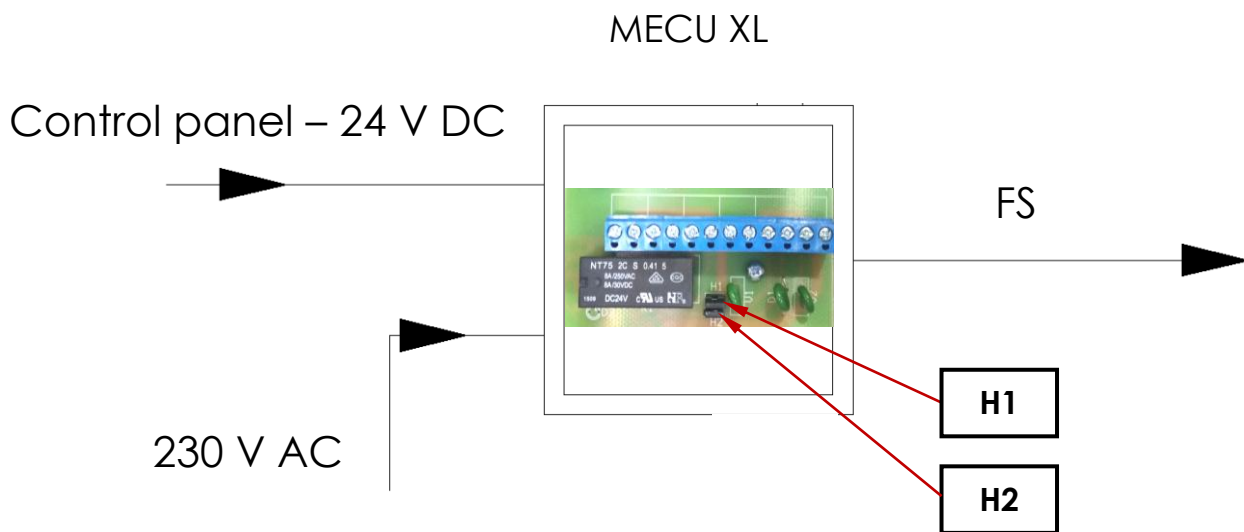


H1 – Removal of the jumper disconnects the brake

H2 – Removal of the jumper disconnects rolling up the curtain

IMPORTANT:

To roll the curtain down to the intermediate position, remove the jumper H2, then temporarily remove the jumper H1, until the curtain descends to the desired position. The installation of the H2 jumper causes the curtain to roll up.

Fig. 12 MECU XL service functions (jumpers).

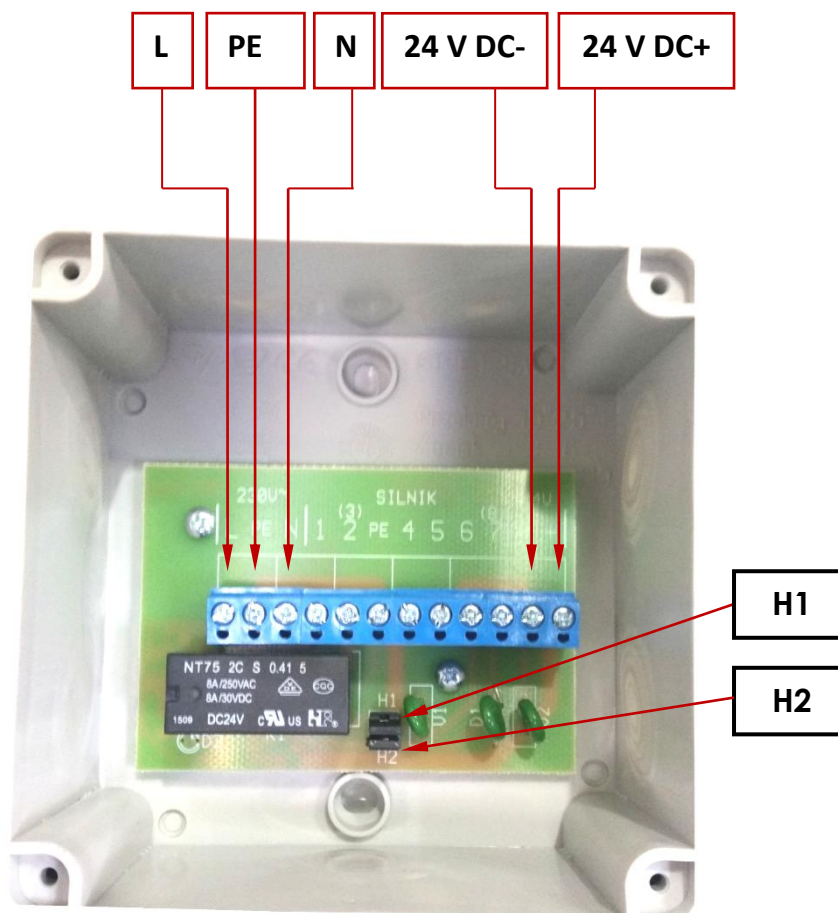

H1 jumper – removal releases the brake 24 V DC – curtain descent

H2 jumper – removal cuts off power supply 230 V AC, prevent curtain roll up

Description of wire terminals inside MECU XL

1, 2, 3, 4, 5, 6, 7, 8, PE	Numbers of motor wires
230 V AC L	
230 V AC PE	Mains
230 V AC N	
24 V DC –	mcr 9705 / mcr 0204 control panel – P8 and P11 terminals
24 V DC +	(brake control) – <u>pay attention to polarity!</u>

Fig. 13 MECU XL connections.

NOTICE:

1. Any decorative or covering elements (e.g. drop ceilings, wall lining) installed later on must not prevent the curtain from dropping freely and must not block possible access to the curtain mechanisms.
2. In the case of fixing curtains with masking elements to a drop ceiling, proper gaps and tolerances should be ensured (Fig. 5, Fig. 6), matching a given curtain width.
3. Do not disconnect the MECU motor control system from the motor!!!
Disconnection or damage to the connection between the MECU system and the motor may result in the rolling out of the fabric. If disconnection is necessary, the curtain should be protected against rolling out.

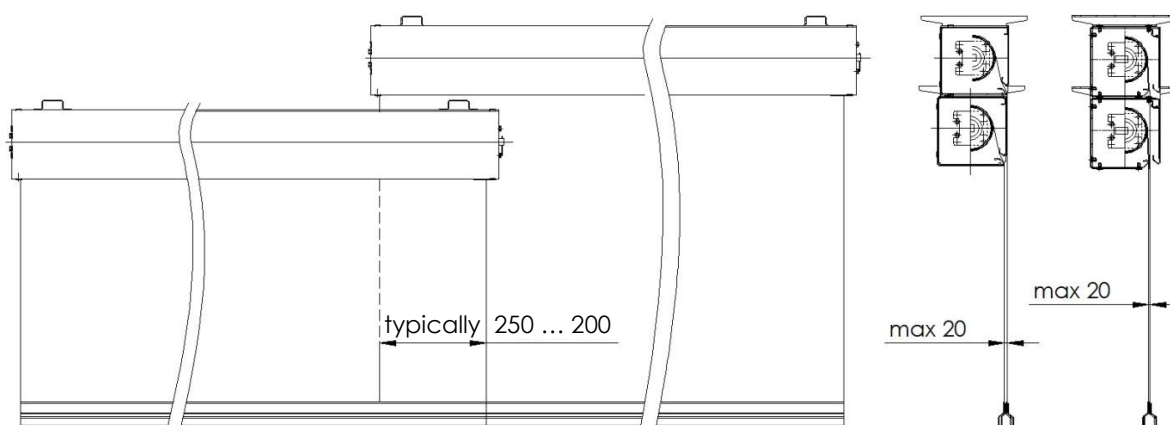


Fig. 14 Typical gap sizes in the transverse direction in the case of vertical arrangement of curtain modules with fabrics overlapping.

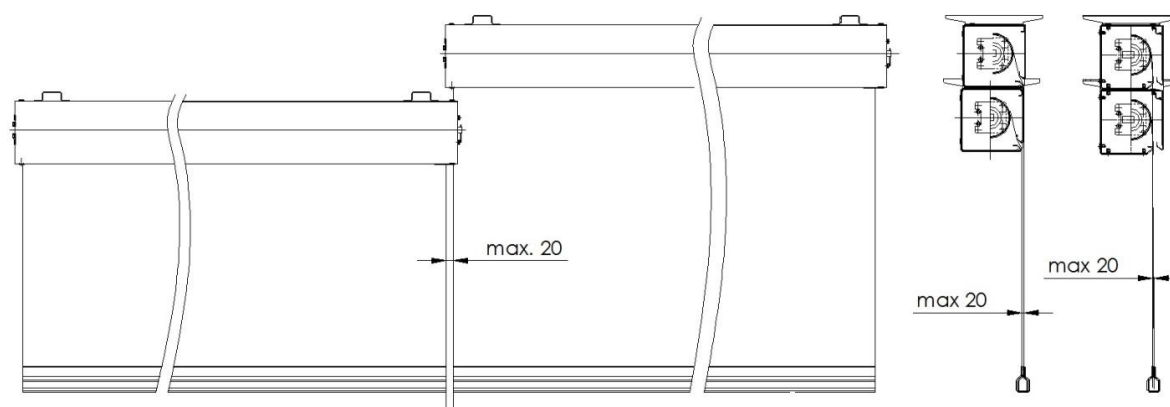


Fig. 15 Typical gap sizes in the transverse direction in the case of vertical arrangement of curtain modules without fabrics overlapping.

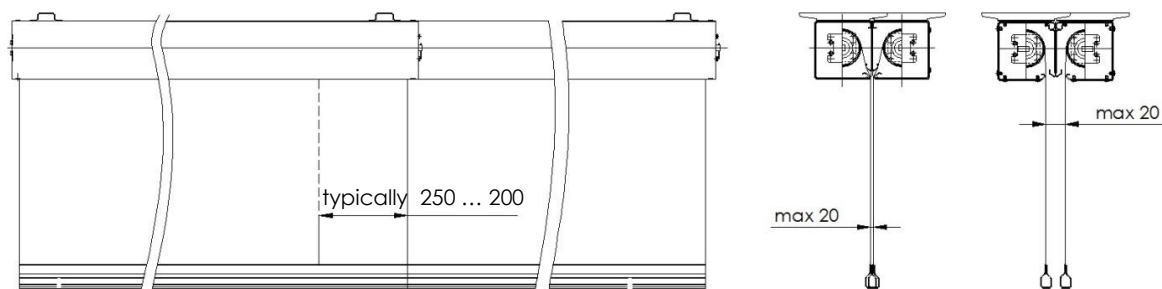


Fig. 16 Typical gap sizes in the transverse direction in the case of butt arrangement of curtain modules with type K, C and L casings and with fabrics overlapping.

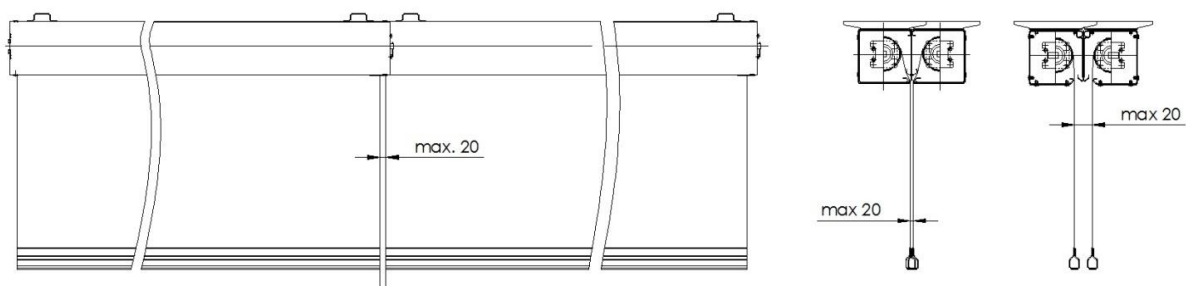


Fig. 17 Typical gap sizes in the transverse direction in the case of butt arrangement of curtain modules with type K, C and L casings and without fabrics overlapping.

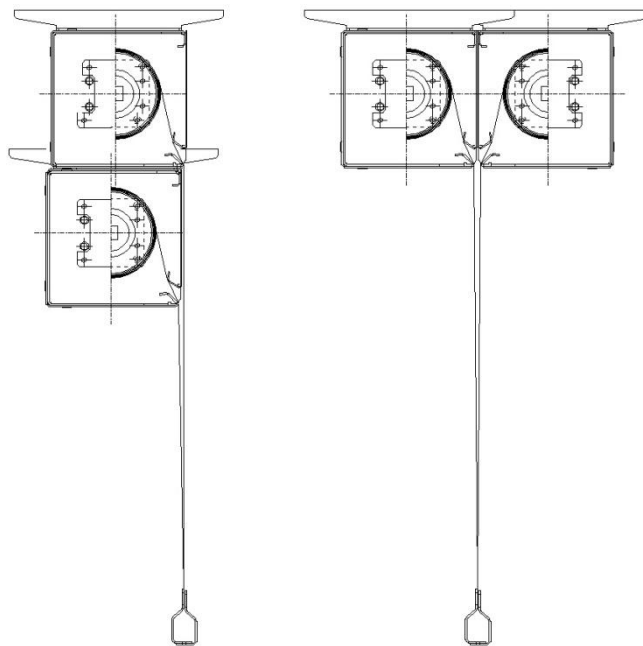


Fig. 18 Reduction in gaps in a group of curtains by using a common bottom bar – type F casings arranged vertically and horizontally.


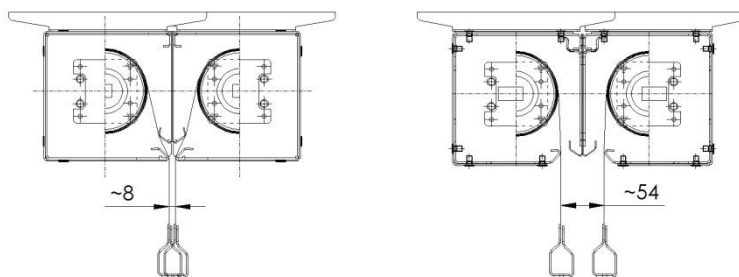


Fig. 19 Typical gap sizes in the transverse direction in the case of butt arrangement of curtains, type K, C and L casings.

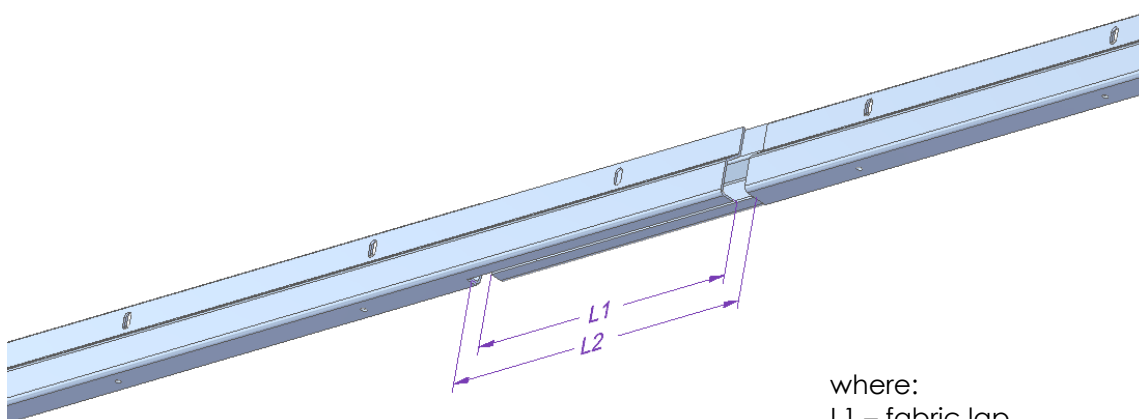

where:
L1 – fabric lap
L2 – bottom bar lap

Fig. 20 Overlapping bottom bar – no connection of curtains by means of a common bottom bar.

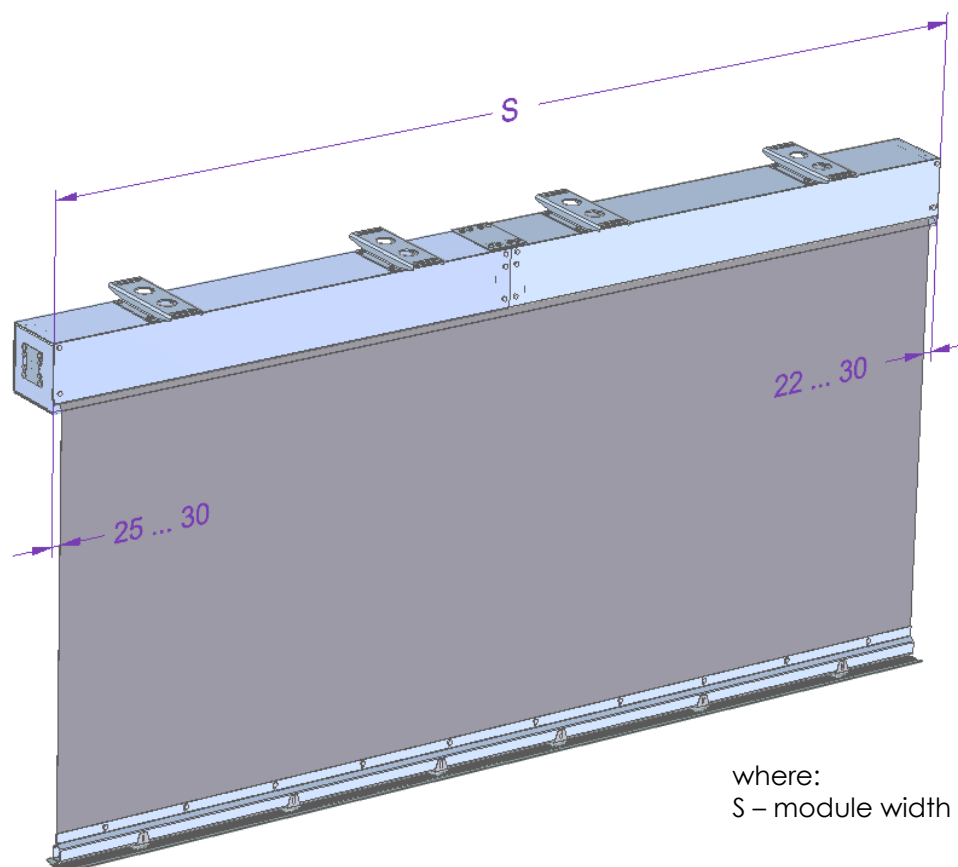


Fig. 21 Lengths of gaps in the longitudinal direction of mcr PROSMOKE FS CE curtains.

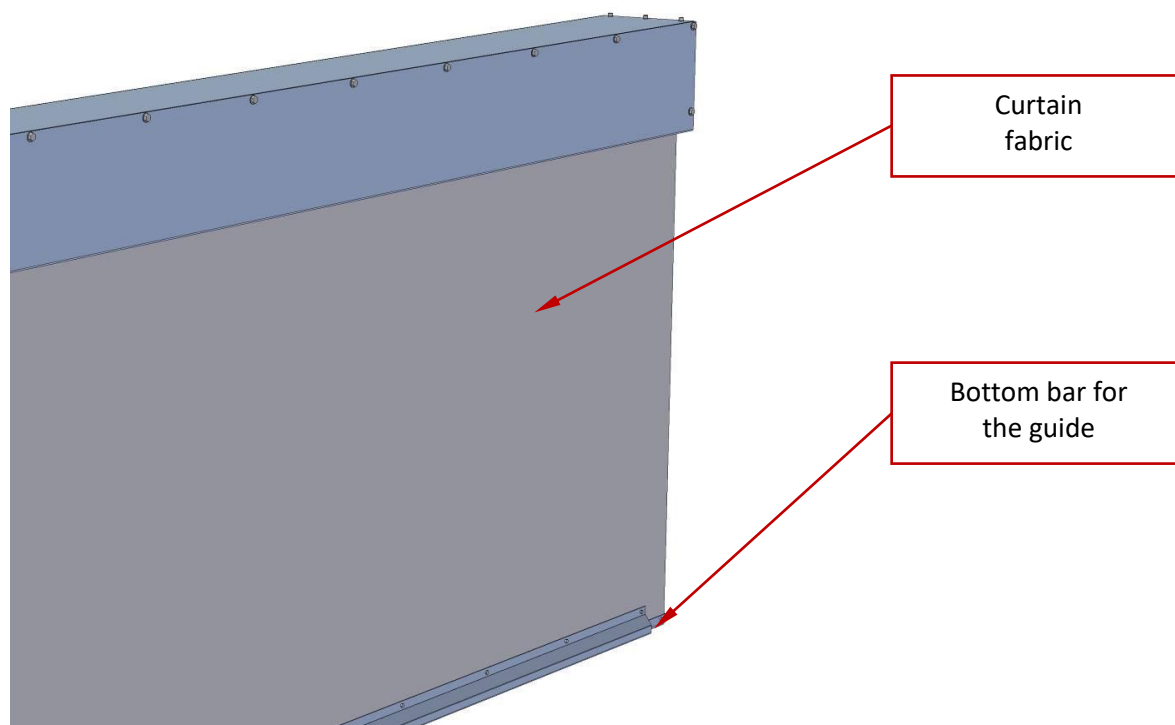


Fig. 22 Curtain ready to be fitted with side guides.

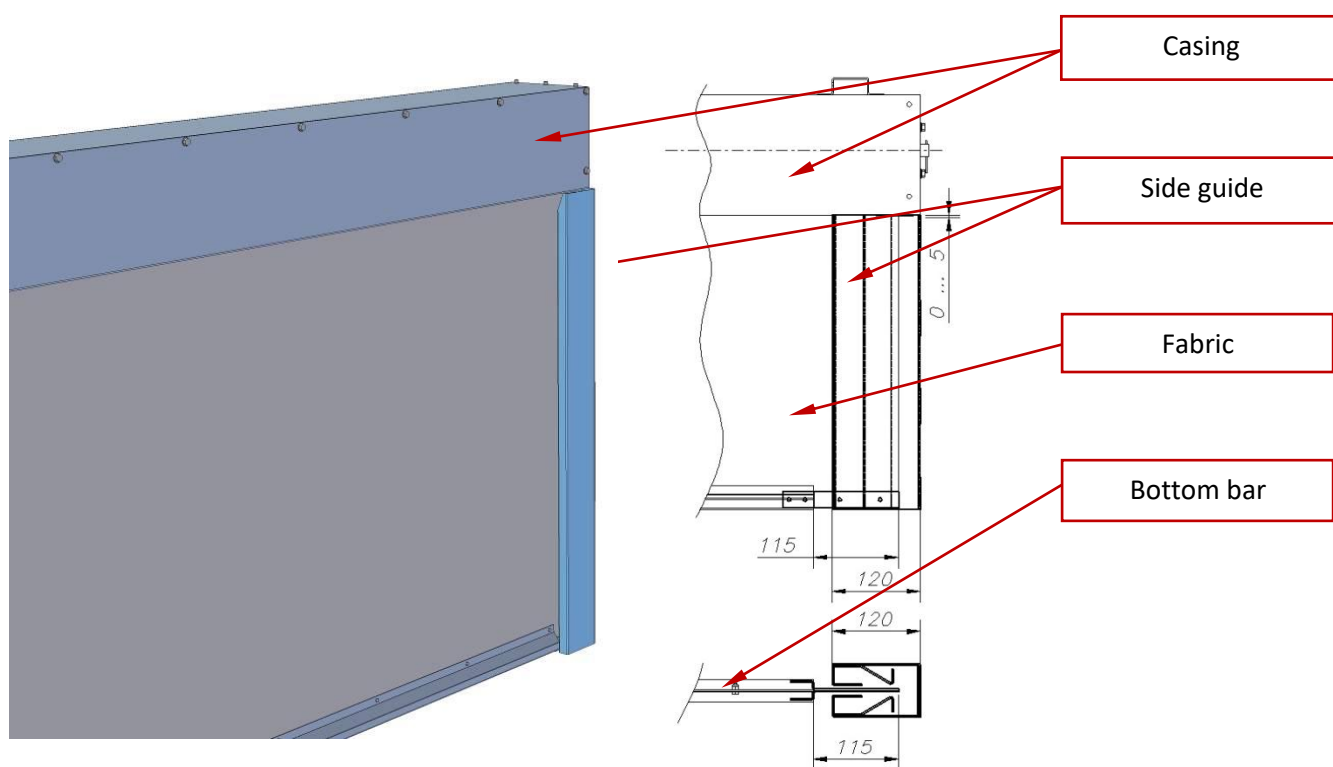


Fig. 23 Method of installing side guides.

7. WARRANTY TERMS AND CONDITIONS

1. Mercor Light&Vent grants a 12-month quality guarantee for equipment, starting from the date of purchase, unless the agreement provides otherwise.
2. Each defect under guarantee should be reported to a local representative of Mercor Light&Vent immediately, i.e. within 7 days of its discovery.
3. Applications can be made by phone at +48/ 58 341 42 45, by email to claim@mercor.com.pl or by sending a letter to: Mercor Light&Vent, Grzegorza z Sanoka 2, 80-408 Gdańsk, Poland.
4. If during the term of guarantee any physical defects of the equipment become evident, Mercor Light&Vent shall remove them as soon as possible, subject to paragraph 5.
5. Mercor Light&Vent reserves the right to lengthen the repair time in the event of complicated repairs or those that require non-standard sub-assemblies [elements] or spare parts to be purchased.
6. Liability under the Guarantee covers only defects resulting from causes inherent in the equipment sold.
7. In the event of defects resulting from inappropriate operation of the equipment or due to other reasons stated in par. 6, the Buyer/ Guarantee Holder shall bear the costs of their removal.
8. In accordance with the generally accepted practice, the guarantee does not cover:
 - damages and breakdowns of the equipment due to inappropriate operation, user's interference, lack of maintenance or periodic servicing;
 - equipment damages resulting from causes other than those that Mercor is responsible for, in particular: acts of God such as torrential rainfall, flood, hurricane, flooding, stroke of thunder, overvoltage in the mains, explosion, hail, fall of aircraft, fire, avalanche, landslide and secondary damages due to the above-listed causes. Torrential rain is defined as rain with an efficiency index of at least 4 (or 5 in Chomicz scale or torrential rain grade IV (A₄)). Should it be impossible to determine the index mentioned in the previous sentence, the actual condition and the degree of damage at the place of its origin proving that it is the consequence of torrential rain will be considered. Hurricane is defined as wind blowing at the speed of at least 17,5 m/s (damages are deemed to have been caused by hurricane if the effects of hurricane have been found in the immediate neighborhood);
 - damages due to failure to immediately report the defect discovered;
 - worsened quality of coating due to the natural ageing process (fading, oxidation);
 - defects due to using abrasive or aggressive cleaning products;
 - damages due to aggressive external factors, especially chemical and biological ones.
 - parts liable to natural wear and tear during operation (e.g. seals) unless a manufacturing fault has occurred;
 - damages due to improper transport, unloading and storage of the device;
 - damages due to installation inconsistent with the OMM and the rules of good construction practice;
 - ingress of dust, particles or solids with the effective grain size below 50 µm into the polycarbonate sheet chambers;
 - condensation in the polycarbonate sheet chambers.
9. Guarantee and warranty is void in the following cases:
 - The Buyer/Guarantee Holder makes design modifications on his own without consulting Mercor Light&Vent,
 - Maintenance or periodic servicing are not done in due time or are performed by unauthorized persons or a service center not authorized by Mercor Light&Vent, or the equipment is operated in the wrong way,
 - Any interference of unauthorized persons – except activities connected with normal operation of the equipment.
10. The Buyer/Guarantee Holder is responsible for proper operation and maintenance of the equipment and for regular (min. twice a year) servicing according to service and maintenance instructions included in OMM.


SERVICING INSPECTIONS:

1. Devices should be subject to periodical servicing inspections every 6 months during the entire period of their operation.
2. The servicing inspections should be performed by companies having adequate authorization of Mercor Light&Vent.
3. On issues related to service please contact a local representative of Mercor Light&Vent.

Other conditions:

1. As regards matters not regulated by these "Warranty terms and conditions", the law applicable is Polish law.
2. Any disputes that may arise in connection with the "Warranty terms and conditions" shall be settled through negotiations between the Parties. This provision is not an arbitration clause.
3. If the Parties fail to reach an agreement by negotiation, any disputes arising from or related to the contract shall be settled by the Polish court competent for the seat of the Seller.

8. CERTIFICATE CPR

 Reg. No. 041/P-007	NOTIFIED BODY 1396 Osloboditeľov 282, 059 35 Batizovce, Slovakia Tel.+421 52 285 1611, www.fires.sk	 The Experts on Fire Safety
Certificate of constancy of performance 1396-CPR-0033		
In compliance with Regulation (EU) No 305/2011 of the European Parliament and of the Council of 9 March 2011 (the Construction products Regulation or CPR), this certificate applies to the construction product		
ACTIVE SMOKE BARRIERS (ASB1, ASB3) mcr PROSMOKE FS CE		
designed to control the movement of fire effluent within construction works by forming a barrier. Assessment and verification of constancy of performance and conditions of product use are defined in document Initial type testing report of constructional product No. C1396/09/0001/5004/SC (issued by FIRES, s.r.o., Batizovce, NB1396 on 10. 06. 2009) and reports of continuous surveillances of factory production control, carried out during the validity of the certificate. The product is		
placed on the market under the name or trade mark of the manufacturer		
Mercor Light&Vent sp. z o.o. ul. Grzegorza z Sanoka 2, 80 – 408 Gdańsk, Poland		
and produced in the manufacturing plant		
Mercor Light&Vent sp. z o.o. ul. Kwarcowa 3A, Ciepłowo, 83-031 Łęgowo, Poland.		
This certificate attests that all provisions concerning the assessment and verification of constancy of performance described in Annex ZA of the standard		
EN 12101-1: 2005, EN 12101-1: 2005/A1: 2006		
under system 1 for the performance set out in this certificate are applied and that the factory production control conducted by the manufacturer is assessed to ensure the		
constancy of performance of the construction product.		
This certificate was first issued on 10. 06. 2009 and will remain valid as long as neither the harmonized standard, the construction product, the AVCP methods nor the manufacturing conditions in the plant are modified significantly, unless suspended or withdrawn by the notified product certification body.		
In Batizovce, on 30. 06. 2025 173674	 -1- NOTIFIED BODY 1396	Representative of Notified Body  Ing. Štefan Rástocký Head of Product Certification Body
FIRES 136a/C-23/10/2024-E		